


Building: SHFMU "Mirali Sejdiu"
Location: Gërmovë, Viti

Design Company: Consult-Eng

Data: 2024

Existing Pumps Curve: $Q_{\max}=30 \text{ m}^3/\text{h}$, $H_{\max}=12 \text{ m}$, PN6/10, 50 Hz / 3x400 V

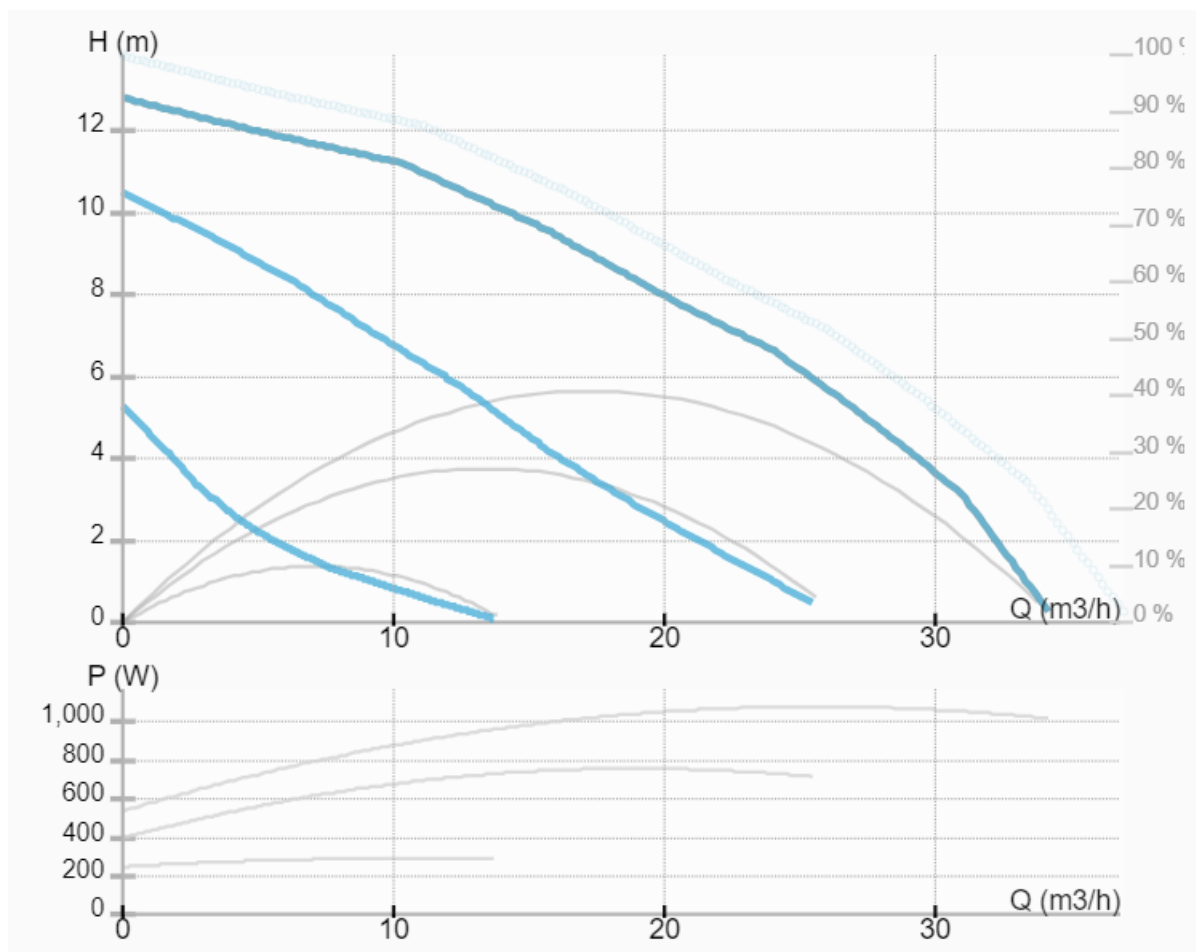

New Variable Speed Pump Curve:

$Q_{\max}=50.2 \text{ m}^3/\text{h}$, $H_{\max}=12 \text{ m}$, DN65, $P_{\max}=810 \text{ W}$, 1x230 V, 50Hz, PN10

Diagram

