



New boiler room

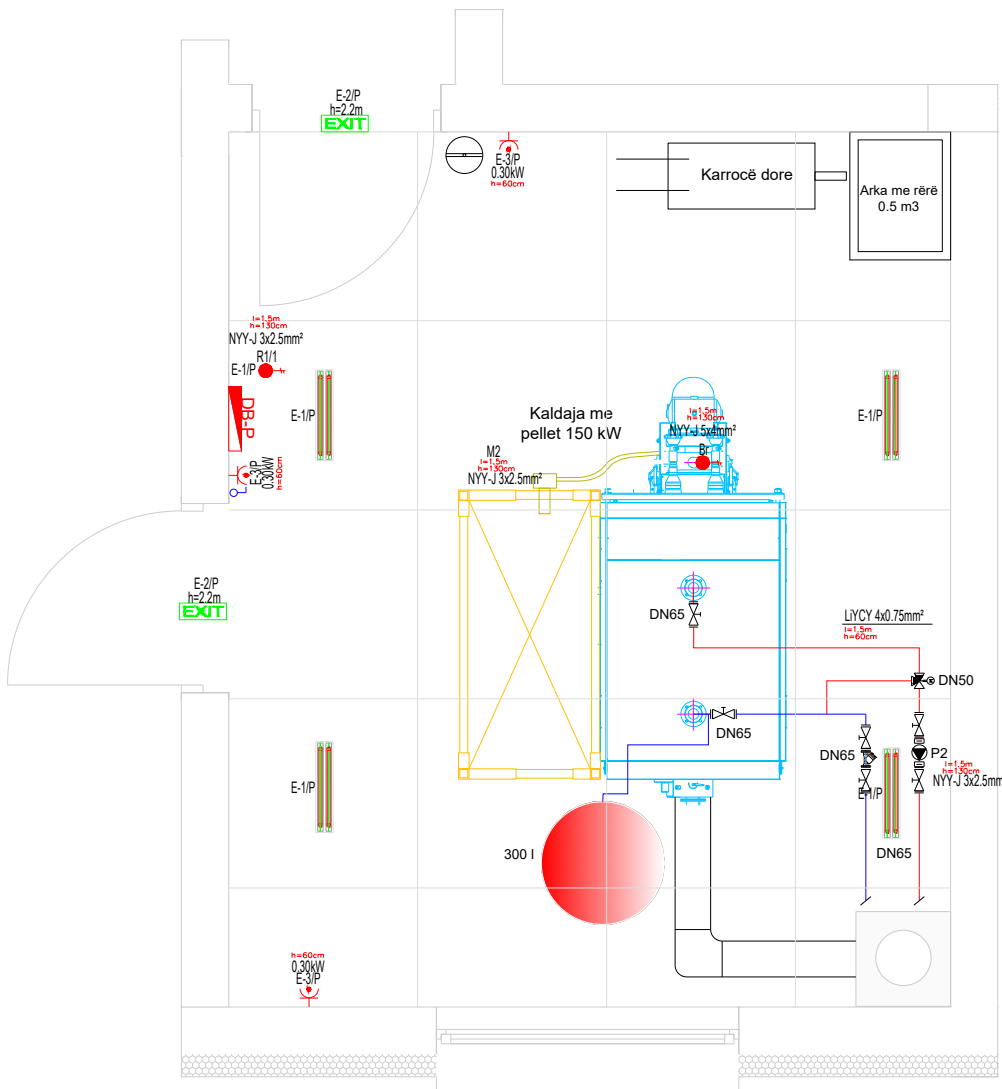

New pump:

<b>P2</b>	New variable speed pump / pompa e re me shpejtësi variable Qmax=50.2 m³/h, Hmax=12 m, P=810 W, DN65, PN6/10, 1x230V / 50 Hz
-----------	--

Details of electric table  
Detalet e tabelës elektrike

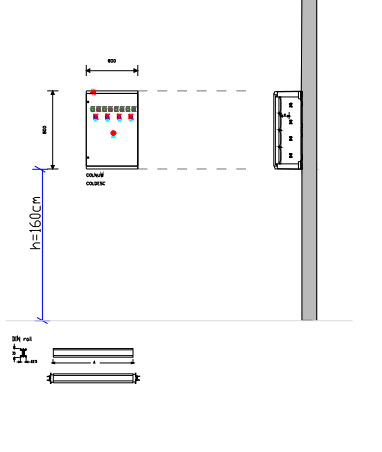

LEGJENDA

	Ndriçues LED 36W, më mbrojtje IP65, me mbules opale polikarbonat.
	Trup ndriçues emergjente led 1x6W, IP 41, NiCd 1h.
	Nderprerës njëpolare 10A, 220V, 50Hz . (according to DIN 49440).
	Prize energjetike me mbules ,16A,220V,50Hz (according to DIN 49440)
	Kablllo furnizuese 1f(220V) Kablllo furnizuese 1f(220V)
	Tabela shperndarese

LEGJENDA

	LED waterproof light fixtures 36W, with cover polycarbonate opal with protection IP65:
	Emergency luminaries led 1x6W, IP 41, NiCd 1h.
	One switch 10A, 220V, 50Hz . (according to DIN 49440).
	Cover socket - outlet ,16A,220V,50Hz (according to DIN 49440)
	Cable supply 1f(220V) Cable supply 3f(380V)
	Distributor border



REPUBLIKA E KOSOVËS / REPUBLIC OF KOSOVO  
Fondi i Kosovës për Eficiencë të Energjisë  
Kosovo Energy Efficiency Fund

Title of Consulting Services /  
Titulli i shërbimeve konsultuese:

Consulting Company for Development of detailed energy audit reports, Detailed  
Designs, Technical Specification

Kompani konsultuese per zhvillimin e raporteve te detajuara te auditimit te  
energjisë, dizajneve te detajuara dhe specifikimeve teknike

RFP No /  
Nr. i kontratës: KEEF/1C5.2/CQ/2023/LOT 2

Consulting Company /  
Kompania konsultuese:



Building name /  
Emri i ndërtesës: **SHFMU "Miralj Sejdiu"**  
Gërmovë, Viti

Project phase /  
Faza e projektimit: **Electrical  
Elektrika**

Drawing layout /  
Emri i vizatimit: **Cable and power sockets in heating system-  
Kablllot energjetike per priza per nenstacioni i ngrohjes**

Drawn by /  
Punuar nga: **MSc.Lulzim Halitaj**  
Checked by /  
Kontrolluar nga: **MSc.Lulzim Halitaj**

Date /  
Date: **02/2024**  
Revision /  
Rishikim: **01**

Drawing scale /  
Shkalla e zvogëlimit: **1:100**  
Page no  
Nr. i faqes: **03**